富士電機グループPOD



モニタッチ V8 シリーズ

V812 取扱説明書

モニタッチ V812 をお買い上げいただき、誠にありがとうございます。 はじめに、ご希望どおりの商品であるかをご確認ください。取り扱いにつきましては、この取扱説明 書および『V8 シリーズ ハード仕様書』を十分ご理解の上ご使用ください。

本書: 1 部、取付金具: 4 個、USB 固定用インシュロック: 1 個

型式

	1	画面サイズ	12	12 インチ
	2	機能仕様	i	高機能品
	4	茂肥江 宋	なし	標準品
V042	3	デバイス仕様	S	TFT カラー LCD (SVGA、65,536 色)
V8 <u>12</u> 🗆 🗆 🗆 🗆	4	タッチスイッチ 仕様	なし	アナログ方式
			M	マトリックス方式
1 2 3 4 5 6	5	電源仕様	なし	AC100-240V 仕様
	١	电源江水	D	DC24V 仕様 (CE/UL/cUL 対応品)
	6	通信ユニット	N	通信ユニット「CUN-xx」専用
		コネクタ (CN5) 仕様	なし	通信ユニット「CU-xx」専用

安全上のご注意

本書はモニタッチを安全に使用していただくために、注意事項のランクを「危険」、「注意」に分けて、下記のような表示で表しています。



取り扱いを誤った場合、死亡または重傷を招く差し迫った危険な状況を示しま



取り扱いを誤った場合、<u>軽傷または中程度の傷害を招く可能性がある状況、</u> および物的損害の発生が予想される危険な状況を示します。

なお、 注 意 に記載した事項でも、状況によっては重大な結果に結びつく可能性があります。

⚠ 危 険

- ・モニタッチのタッチスイッチなどの出力機能を、人命や機器の破損にかかわるところや、緊急 用の非常スイッチ機能として、使用しないでください。また、タッチスイッチの故障に対応できるシステム設計を行ってください。タッチスイッチの故障により、機械の破損や事故の恐れ
- ◆装置の組立、配線作業、および保守・点検は必ず電源を切ってから行ってください。感電や破 最高を加え、記録による。 横の恐れがあります。 通電中は絶対に端子に触れないでください。感電の恐れがあります。
- 通電、運転を行う場合は、必ず端子カバーを取り付けてください。端子カバーを取り付けないと、感電の恐れがあります。
 液晶パネルの液体(液晶)は、有害物質です。液晶パネルが損傷した場合、流出した液晶を口
- に入れないでください。皮膚や衣服についた場合は、石鹸などで洗い流してください。 ・リチウム電池の +- 逆接続、充電、分解、加圧変形、火中への投入、短絡はしないでください。 破裂、発火の恐れがあります。
- リチウム電池の変形、液漏れ、その他の異常に気が付いた際は使用しないでください。破裂、
- リチウム電池の変形、液漏れ、その他の異常に気か付いた際は使用しないでください。破裂、 発火の恐れがあります。 パックライトの寿命・故障等によって画面が暗くなった場合、POWER ランプが点滅します。こ の時、画面上のスイッチは有効です。画面が暗くて見にくい状態で、かつ POWER ランブが点 滅している時は、画面に触れないようにしてください。誤作動による機械の破損、事故の恐れ があります。

⚠ 注 意

- 開梱時に外観チェックを行ってください。損傷、変形のあるものは使用しないでください。火 災、誤動作、故障の原因となります。 ・原子力関連、航空宇宙関連、医療関連、交通機器関連、乗用移動体関連あるいはこれらのシス

- す。 下記のような場所には使用(保管)しないでください。故障、火災の原因となります。 水、腐食ガス、可燃性ガス、溶剤、研削液、切削油等に直接触れる場所 高温、結構、風雨、直射日光にさらされる場所 じんあい、塩分、鉄粉が多い場所 振動、衝撃が直接加わるような場所

- 振動、衝撃が直接加わるような場所 機器への導入に際して、モニタッチの主電源端子に容易に触れないように、正しく取り付けて ください。感電、事故の恐れがあります。 ・モニタッチの取付金具の締め付けは規定トルク範囲で行ってください。締め付けすぎるとパネ ル面が変形する恐れがあります。締め付けがゆるいと落下、短絡、誤動作の原因になります。 ・電源入力部端子台の端子ネジおよび取付金具は、規定トルク範囲で均等に締め付けてください。 ・織め付けに不備があると、火災、誤動作、故障の原因となりますので、締め付けが確実に 行われていることを定期的に確認してください。
- モニタッチは表示部にガラスを使用しているので、落下させたり強い衝撃を与えないでください。破損の恐れがあります。 モニタッチへの配線は定格電圧、定格電力を考慮して正しく端子に配線してください。定格外
- の電源を供給したり、誤配線した場合は製品の破損、故障、火災の原因になります。 モニタッチは必ず接地してください。FG 端子は D 種接地のモニタッチ専用で接地してください。感電、火災の原因となります。
- モニタッチ内に導電性異物が入らないように注意してください。火災、故障、誤動作の原因に
- なります。 配線終了後は、モニタッチのゴミヨケ紙を取り外して運転してください。ゴミヨケ紙を付けた
- 配線終了後は、モニタッチのコミョケ紙を取り外して連転してください。コミョケ紙を付けたまま運転を行うと、火災、事故、誤動作、故障の原因となります。
 モニタッチの修理・分解・改造はその場では絶対に行わないで、弊社または弊社指定業者へ修理依頼してください。故障の原因となります。
 モニタッチの修理・分解・改造を、弊社以外、もしくは弊社指定以外の第三者が行った場合に、それが原因で生じた損害等につきましては責任を負いかねますのでご了承ください。
 先が鋭利な物でタッチスイッチを押さないでください。
 取付、配線作業および保守・点検は専門知識を持つ人が行ってください。
- ・取り、記録に来るものは、「無快は等」が過ぎませんがよっているとか。取り扱いを誤る ・リチウム電池はリチウムや有機溶媒などの可能性物質を内蔵しているとめ、取り扱いを誤る と、発熱、破裂発火などにより、けがをしたり、火災に至る恐れがあります。本書および関連 マニュアル記載の注意事項を守って正しく取り扱いください。
- ・スイッチ分解能がアナログ抵抗膜方式のモニタッチをご使用の場合、スクリーン上を同時に2 点以上押さないでください。同時に2点以上押した場合、押した点の中心にスイッチがあると、そのスイッチが動作することがあります。
- で、てのスイッチが到作することがあります。 運転中の設定変更、強制出力、起動、停止などの操作は十分安全を確認してから行ってください。操作ミスにより機械が動作し、機械の破損や事故の恐れがあります。 モニタッチが故障することにより、人命に関わったり重大な損失の発生が予測される設備への
- 適用に際しては必ず安全装置を設置してください。

- 適用に際しては必ず安全装置を設置してください。

 ・モニタッチを廃棄するときは、産業廃棄物として扱ってください。
 ・モニタッチに触れる前には、接地された金属などに触れて、人体などに帯電している静電気を放電させてください。適大な静電気は、誤動作、故障の原因となります。

 CFカードを本体に挿す際は、挿入面を間違えることのないよう、ご注意、ださい。万が一、誤った向きのまま CF カードを挿し込むと、CF カードまたは本体ソケットが破損する可能性が

- CFカード電源供給中、CFカードカバー内の LED ランプは赤色に点灯します。LED 点灯中に CFカードを抜いたり、本体の電源を OFF すると、CFカード内のデータが破損する恐れがあります。CFカードを抜く、または本体の電源を OFF する場合は IFD の選択を確認した LTC に
- C く にさい。 MJ1、MJ2 のコネクタに LAN ケーブルを接続した場合は、相手側の装置が破損する恐れがあり ます。銘板を確認し、誤挿入しないように注意してください。

液晶について

液晶の特性上、微少な斑点(黒点、輝点)が生じることがあります。 これは、製品の不良・故障ではありません。あらかじめご了承ください。

UL/c-UL マークについて

V812 は、UL/c-UL 認定品です。(File No.: E313548 (UL508)) 以下の2つの規格に適合しています。

- UL508:工業用制御装置
- CSA-C22.2 No. 142-M1987: 工業用制御装置

モニタッチを組み込んだ機器を UL 申請する場合

- モニタッチの背面部分はエンクロージャとして認定されていません。モニタッチは機器に組み込
- → スポーターの場合を表して現格に適合するエンクロージャを構成してください。
 ◆ モニタッチは室内専用機としてご使用ください。
 ◆ エンクロージャのタイプはタイプ1が適合するような平面上に取り付けてください。 • 電源を配線する際に使用する圧着端子には、UL 認定品を使用してください。

ネジサイズ	締め付けトルク	電源ケーブル
M3.5	7.1 inch-lbf (0.8N • m)	AWG16 - AWG18、定格温度 60 ℃、銅線使用

• DC24V 入力機は、必ず Class 2 電源を使用してください。

CE マーキングについて


- V812は、EMC 指令に適合した製品です。 EN61000-6-2、EN61000-6-4に適合しています。
 V812は「Class A」工業用環境商品です。住宅環境で使用する場合、電波妨害の
- 原因となる可能性があるため、電波妨害に対する適切な対策が必要となります。

一般仕様

	項目	AC 電源仕様	DC 電源仕様			
	でE マーキング	八〇 电脉 压 水	EN61000-6-2、EN61000-6-4			
対応規格	UL/cUL		UL508			
定格電圧	CLIGOL	AC100-240V	DC24V			
電圧許容範	#	-15 % ~ +10 %	± 10 %			
許容瞬時停		20ms 以内	DC24V 1ms 以内			
消費電力(70VA 以下	30W 以下			
突入電流	- NCIB?	AC100V 20A 以下(10ms 以下) AC200V 40A 以下(10ms 以下)	DC24V 30A 以下 (1ms 以下)			
耐電圧		AC 外部端子と FG 間: AC1500V、 DC 外部端子と FG 間: AC500V、				
絶縁抵抗		DC500V、10MΩ以上				
使用周囲温	度	0°C ~ +50°C ^{*1}				
保存周囲温	度	-10°C ~ +60°C ^{*1}				
使用周囲湿	度	85%RH 以下(結露なきこと) ^{*1}				
保存周囲湿	度	85%RH 以下(結露なきこと) ^{*1}				
使用高度		標高 2000m 以下				
使用雰囲気		腐食性ガスがなく、じんあいがひどくないこと、 および導電性のじんあいがないこと				
耐振動		振動周波数: 10 ~ 150Hz、加速度: 9.8m/s ² (1.0G) 片振幅: 0.075mm、X, Y, Z: 3 方向 各 1 時間				
耐衝撃		パルス波形:正弦半波、ピーク加速度:147m/s ² (15G) X, Y, Z :3 方向、各 6 回				
耐ノイズ		1500Vp-p(パルス幅 1μs、立ち上	ニがり時間:1ns)			
耐静電気放	電	IEC61000-4-2 に準拠、接触 6kV、気中 8kV				
汚染度 *2		2				
接地		D種接地(第3種接地)、FG/SG分離				
構造		保護構造 : フロントパネル: IP65 準拠 リヤーケース : IP20 準拠 形状 : 一体形 取付方法 : パネル埋込取付 板金板厚 : 1.5 ~ 5mm ^{*3}				
冷却方式		自然空冷				
質量		アナログ抵抗膜方式 : 約 2.4 kg マトリックス抵抗膜方式: 約 2.8 kg				
外形寸法 V	V×H×D	326.4 × 259.6 × 69.0 mm				
パネルカッ	 ト寸法	313.0 ^{+0.5} ₋₀ × 246.2 ^{+0.5} ₋₀ mm				
材質		PC/ABS				

- 最大湿球温度 39°C 以下
- 本製品を使用した環境における導電性物質の発生度合を示す指標です。 「汚染度 2」は、非導電性の汚染のみ発生する状況を示します。ただし、凝結によって一時的 な導電が起こりうる環境です。
- ない。 板金板厚が仕様範囲内であっても、板金の材質や大きさによってはパネル自体が反る場合があ ります。取り付け強度が保てるパネルをご使用ください。

各部の名称と寸法

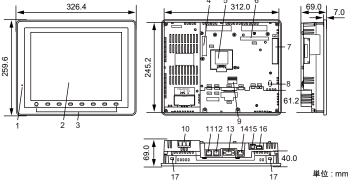

1. Power ランプ (POWER) 7. CF カードコネクタ (CF) 2. ディスプレイ 8. USB 固定用取り付け穴 3. ファンクションスイッチ 9 ディップスイッチ

4. 通信ユニットコネクタ (CN5) * 10. 電源入力端子台

5 雷池ホルダ 11. モジュラージャック 1 (MJ1) 17. 取付金具穴 6. GU ユニットコネクタ (CN7) 12. モジュラージャック 2 (MJ2)

* V8 の型式によって、対応通信ユニットが異なります。 「N」あり: 通信ユニット「CUN-xx」対応 「N」なし: 通信ユニット「CU-xx」対応

インタフェース

Dsub9ピン (CN1)

外部機器とシリアル通信(RS-232C•RS-422/RS-485)接続するためのコネクタです。

CN1	ピン		RS-232C		-422/RS-485 ^{*1}
(Female、インチネジ)	No.	信号名	内容	信号名	内容
	1	NC	未使用	+RD	受信データ (+)
	2	RD	受信データ	-RD	受信データ (-)
5 1	3	SD	送信データ	-SD	送信データ (-)
(\(\dots \) (\dots	4	NC	未使用	+SD	送信データ (+)
(0000)	5	SG	シグナルグランド	SG	シグナルグランド
9 6	6	NC	未使用	+RS	送信要求(+)
FG は筐体接地。	7	RS	送信要求	-RS	送信要求(-)
	8	CS	送信可	NC	未使用
	9	NC	未使用	+5V	使用不可*2

- 信号レベル (RS-232C•RS-422/RS-485) は、ソフトウェアの設定により切り替えます。信号 レベルを RS-232C に設定した場合、ディップスイッチの No.5、7 は必ず OFF してください。
- *2 特定の機器との通信時に、終端抵抗用電源として使用します。外部供給用電源としては使用で

モジュラージャック(MJ1/MJ2)

外部機器とシリアル通信 (RS-232C•RS-422/RS-485)、または画面転送 (MJ1 のみ) するためのコネ

MJ1/MJ2	ピン No.	信号名	内容
	1	+RD/+SD	RS-485 データ(+)
	2	-RD/-SD	RS-485 データ (-)
	3	+5V	外部供給 +5V、MAX 150mA
	4		7ド即決和 TOV、IVIAA TOUTIA
	5	SG	シグナルグランド
87654321	6	30	ジグテルグラント
FG は筐体接地。	7	RD	RS-232C 受信データ
	8	SD	RS-232C 送信データ

* 外部供給(+5V)は、フルオプション(通信ユニット+オプションユニット同時装着)時、フル オプション以外の時で、値が変わります。 詳しくは別途『V8 シリーズ ハード仕様書』を参照してください。

LAN コネクタ(LAN) V812i のみ

Ethernet (100BASE-TX、10BASE-TX) 接続するためのポートです。 仕様: IEEE802.3(u) 準拠、UDP/IP および TCP/IP 対応



- MJ1/MJ2 および LAN コネクタは共に8 ピンモジュラージャックです。銘板を確認し、誤挿入しないように注意してください。
 LAN ボートに接続する際、過電圧を持ち合わせている周辺機器との接続は避け
- てください。

LAN コネクタ、LAN ケーブル等について、詳しくは別途『V8 シリーズ ハード仕様書』を参照して

USB ポート (USB Ver. 1.1)

タイプ	USB-A(マスター)	USB-B(スレーブ)
用途	USB 対応プリンタ(EPSON PM プリンタ)、 USB-CFREC 接続など	パソコン接続(画面転送)、 PictBridge プリンタ接続

USB ポートの使い方等について、詳しくは別途『V8 シリーズ ハード仕様書』を参照してください。

ディップスイッチ

ディップスイッチの設定は以下のとおりです。(下図:工場出荷時の状態) ディップスイッチを設定する際は、本体電源を OFF してから行ってください。

	No.	中亞	No.	th size
(拡大図)	INO.	内容	INO.	内容
ON	1	CF 自動アップロード	5	CN1 +SD/-SD 終端抵抗
	2	CF アクセス制御	6	MJ1 終端抵抗
1 2 3 4 5 6 7 8	3	土体田	7	CN1 +RD/-RD 終端抵抗
	4	未使用	8	MJ2 終端抵抗

設定内容について、詳しくは別途『V8 シリーズ ハード仕様書』をご参照ください。

取付方法

13. D-sub 9 ピン コネクタ (CN1)

14. LAN コネクタ (LAN)

15 USB-B ポート (U-B)

16. USB-A ポート (U-A)

取付方法


- 板金パネル(最大板厚 5mm)に V8 を挿入します。
- 2. 付属の取付金具(取付金具の数:4個)を V8 の取付穴に挿入し、締め付けネジで V8 を固定し ます。(締め付けトルク: 0.5 ~ 0.7N • m)
- * 静電気対策として板金パネルをアースに接続してください。



3. 防水パッキンは、板金パネルと V8 の間にしっかりと挟んで取り付けてください。

取付角度

取付角度は 15°~ 135°の範囲内で設置してください。



AC100-240V 仕様 DC24V 仕様

<u>-</u>₩

電源ケーブルの配線と接地について

↑ 危 険 | 感電の恐れがあります。電源ケーブルの配線は電源 OFF 状態で行って

電源ケーブルの配線

• 電源ケーブルは本体背面の端子に接続します。 電源を配線する場合の締め付けは下記値で行って

ネジサイズ 締め付けトルク

M3.5 7.1 inch-lbf (0.8N • m) • 電源は許容電源電圧変動範囲内で使用してくださ

• 線間及び大地間ともノイズの少ない電源を使用し

電源線は電圧降下を小さくするために、できるだけ太い線を使用してください。


電源線は高電圧、大電流のケーブルとは近づけないように十分に離してください。端子台には必ず端子カバーを取り付けてください。

⚠ 注意

モニタッチは、必ず接地をしてください。

 アースは専用接地にしてください。
 接地用のケーブルには公称断面積 2mm² 以上のものを使用してください。 • 接地点は本体の近くにし、接地線の距離を短くしてください。

専用接地 (最良) 共用接地 (良) V8 本体 V8 本体



コイン型リチウム電池について

SRAM ユーザメモリ領域(不揮発性メモリ \$L、\$LD やサンプリングデータの格納など)と内蔵時計 のバックアップ用の雷池です。

/ 注意 | 工場出荷時、電池ケーブルは接続されていません。 電池の仕様、交換方法、および使用済電池の破棄方法について、詳しくは別途『V8 シリーズ ハー

ド仕様書』を参照してください。 接地用のケーブルには公称断面積 2mm² 以上のものを使用してください。

接地点は本体の近くにし、接地線の距離を短くしてください。

発紘電機株式会社

〒924-0035 石川県白山市上柏野町890番1 URL http://www.hakko-elec.co.jp

商品に関するお問い合わせは、下記へご連絡ください。 営業窓口 TEL(076)274-5210 / FAX(076)274-5200

モニタッチの技術的なお問い合わせは、下記へご連絡ください。

技術相談窓口 TEL(076)274-5130/FAX(076)274-5208



MONITOUCH V8 Series

V812 OPERATING INSTRUCTIONS


Make sure that the delivered unit conforms to your requirement, and also check for any missing o

damaged parts.

Before using this V812, be sure to read this OPERATING INSTRUCTIONS as well as the V8 Series Hardware Specifications manual thoroughly to ensure proper operation

This manual: 1 copy, Fixtures: 4 pcs, USB cable tie: 1 pce

Model

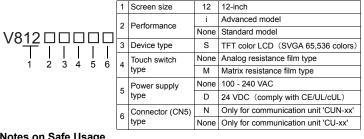

Notes on Safe Usage

In this "V810 OPERATING INSTRUCTIONS", you will find various notes categorized under the following two levels with the signal words "Danger" and "Caution.



Indicates an imminently hazardous situation which, if not avoided, will result in death or serious injury.



Indicates a potentially hazardous situation which, if not avoided, may result in minor or moderate injury and could cause property damage.

Even some items indicated " CAUTION" may also result in serious accidents



- DANGER
- Never use the output function of MONITOUCH for operations that may threaten human life or to damage the system, such as switches to be used in case of emergency. Please design the system so that it can cope with malfunction of a touch switch. A malfunction of the touch switch will result in machine accident or damage.
- Turn off the power supply when you set up the unit, connect cables or perform maintenance and inspection. Otherwise, electrical shock or damage may occur.
- Never touch any terminals while the power is on. Otherwise, electrical shock may occur. · You must put a cover on the terminals on the unit when you turn the power on and operate the unit. Without the terminal cover in place, an electric shock may occur
- The liquid crystal in the LCD panel is a hazardous substance. If the LCD panel is damaged, do not ingest the leaked liquid crystal. If the liquid crystal spills on your skin or clothing, use soap and wash off thoroughly.
- For MONITOUCH using a lithium battery, never disassemble, recharge, deform by pressure short-circuit, reverse the polarity of the battery, or dispose of the battery in fire. Failure to follow these conditions will lead to explosion or ignition.
- For MONITOUCH using a lithium battery, never use a battery that is deformed, leaks, or shows any other signs of abnormality. Failure to follow these conditions will lead to explosion or ignition.

 The power lamp flashes when the backlight is at the end of life or is faulty. However, the switches
- on the screen are operable at this time. Do not touch the screen when the screen becomes dark and the power lamp flashes. Otherwise, a malfunction may occur and result in machine accident or damage.



CAUTION

- Check the appearance of the unit when it is unpacked. Do not use the unit if any damage or deformation is found. Failure to do so may lead to fire, damage or malfunction
- For use in a facility or for a system related to nuclear energy, aerospace, medical, traffic
- equipment, or mobile installations, please consult your local distributor.

 Operate (or store) MONITOUCH under the conditions indicated in this manual and related
- nanuals. Failure to do so could cause fire, malfunction, physical damage or deterioration Understand the following environmental limits for use and storage of MONITOUCH. Otherwise fire or damage to the unit may result.
- Avoid locations where there is a possibility that water, corrosive gas, flammable gas,
- solvents, grinding fluids or cutting oil can come into contact with the unit.

 Avoid high temperature, high humidity, and outside weather conditions, such as wind, rain
- or direct sunlight. Avoid locations where excessive dust, salt, and metallic particles are present.
- Avoid installing the unit in a location where vibration or physical shock may be transmitted.
 Equipment must be correctly mounted so that the main terminal of MONITOUCH will not be
- touched inadvertently. Otherwise, an accident or electric shock may occur.

 Tighten the fixtures of MONITOUCH with a torque in the specified range. Excessive tightening may distort the panel surface. Loose tightening may cause MONITOUCH to come off, malfunction or be short-circuited.
- Tighten terminal screws on the power supply terminal block equally with a torque in the specified range. Improper tightening of screws may result in fire, malfunction, or trouble, so check periodically that terminal screws on the power supply terminal block and fixtures are firmly
- MONITOUCH has a glass screen. Do not drop or give physical shock to the unit. Otherwise, the screen may be damaged.
- Connect the cables correctly to the terminals of MONITOUCH in accordance with the specified voltage and wattage. Over-voltage, over-wattage or incorrect cable connection could cause fire malfunction or damage to the unit.

 Be sure to establish a ground of MONITOUCH. Ground FG terminal which must be used for the
- unit. Otherwise, electric shock or a fire may occur Prevent any conductive particles from entering into MONITOUCH. Failure to do so may lead to
- fire, damage or malfunction. After wiring is finished, remove the paper used as a dust cover before starting to operate MONITOUCH. Operation with the cover attached may result in accident, fire, malfunction, or
- Do not attempt to repair, disassemble or modify MONITOUCH at your site. Ask Hakko or the designated contractor for repair. Otherwise, it may cause a malfunction.
- Hakko Electronics Co., Ltd. is not responsible for any damages resulting from repair, overhaul or modification of MONITOUCH that was performed by an unauthorized person.
- Do not use a sharp-pointed tool when pressing a touch switch. Doing so may damage the
- . Only experts are authorized to set up the unit, connect the cables or perform maintenance and inspection

- The combustible materials such as lithium or organic solvent contained in the battery may generate heat, explode, or catch fire, resulting in personal injury or fire. Read related manuals carefully and handle the lithium battery correctly as instructed.
- When using a MONITOUCH that has analog switch resolution with resistance film, do not press
 two or more points on the screen at the same time. If there is a switch between the two pressed points, it may be activated.
- Take safety precautions during such operations as setting change during running, forced output, start, and stop. Any misoperation may cause unexpected machine motions, resulting in machine accident or damage.
- In facilities where a failure of MONITOLICH could lead to accident threatening human life or other serious damage, be sure that the facilities are equipped with adequate safeguards.
- At the time of disposal, MONITOUCH must be treated as industrial waste.
- Before touching MONITOUCH, discharge static electricity from your body by touching grounded metal. Excessive static electricity may cause malfunction or trouble.

 Never insert the CF card in the socket of MONITOUCH with the wrong direction. Doing so may
- destroy the CE card or the socket of MONITOLICH
- The LED lamp on the CF card interface cover lights up in red during supplying power to the CF card. Never remove the CF card or turn off the power of MONITOUCH while the LED lamp is lit. Doing so may destroy the data on the CF card. Check that the LED lamp has gone off before
- removing the CF card or turning off the power of MONITOUCH.

 If a LAN cable is inserted into the MJ1 or MJ2 connector on MONITOUCH, the counterpart device may be damaged. Check the indication on the unit and insert a cable into the correct

Notes on LCD

Tiny spots (dark or luminescent) may appear on the display due to the liquid crystal characteristics. Please note that this is not a fault or malfunction of MONITOUCH.

UL/c-UL Approva

The V812 is UL/cUL-approved. (File No.: E313548 (UL508))

- The V812 conforms to the following two standards.
- UL508 : Industrial Control Equipment CSA-C22.2 No. 142-M1987 : Process Control Equipment

UL Listing Application for a System Equipped with MONITOUCH

- The back panel of MONITOUCH is not approved as an enclosure. For UL listing application, build MONITOUCH in the system, and configure an enclosure so that the entire system will be
- Use MONITOUCH indoors only.
- For use on a flat surface of a type 1 enclosure
 Use a UL-approved crimp-style terminal for wiring of the power supply cable.

Screw Si	ze Tightening Torque	Power Cable
M3.5	7.1 inch-lbf (0.8 N • m) AWG16 - AWG18, Rated temperature 60 °C Use copper conductor only.

• Use the Class 2 power supply for the 24-VDC power unit.

CE Marking

- V812 complies with EMC Directives, EN61000-6-2, EN61000-6-4
- V812 is identified as a class-A product in an industrial environment. In the case of the use in a domestic environment, V812 is likely to cause electromagnetic interference. Preventive measures should thereby be taken appropriately

General Specifications


Ite	m	AC power supply	DC power supply			
Compatible	CE marking		EN61000-6-2、EN61000-6-4			
Specification	UL/cUL	-	UL508			
Rated Voltage		100-240 VAC	24 VDC			
Permissible Rai	nge of Voltage	-15 % to +10 %	± 10 %			
Permissible Mo Power Failure	•	Within 20 ms	24 VDC: Within 1 ms			
Power Consum (Maximum Ratio		70 VA or less	30 W or less			
Rush Current		For 100 VAC: 20 A, 10 ms or less For 200 VAC: 40 A, 10 ms or less	For 24 VDC : 30 A, 1 ms or less			
Withstand Volta	ge	AC external terminals to FG: 1500 VAC, 1 minute	DC external terminals to FG: 500 VAC per minute			
Insulation Resis	stance	500 VDC, 10 MΩ or above				
Surrounding Air	Temperature	0 °C to +50 °C *1				
Storage Surrous Temperature	nding Air	-10 °C to +60 °C *1				
Surrounding Air	Humidity	85 % RH or less (without dew condensation) *1				
Storage Surrous Humidity	nding Air	85 % RH or less (without dew condensation) *1				
Altitude		2000 m or lower				
Atmosphere		No corrosive gas, no excessive dust, and no conductive dust				
Vibration Resistance		Vibration frequency: 10 to 150 Hz, Acceleration: 9.8 m/s² (1.0 G), Half-amplitude: 0.075 mm, 3 directions of X, Y and Z: one hour				
Shock Resistan	се	Pulse shape: Sine half wave, Peak acceleration: 147 m/s ² (15 G), 3 directions of X, Y and Z: 6 times				
Noise Resistant	ce	1500 Vp-p (pulse width 1 μs, rising time: 1 ns)				
Static Electricity Resistance	Discharge	Compliant with IEC61000-4-2, Contact: 6 kV, Air: 8 kV				
Pollution Degre	e *2	For use in Pollution Degree 2				
Grounding		Less than 100 Ω, FG/SG separated				
Structure		Protection structure : front panel complies with IP65 rear case complies with IP20 Form : in a body Mounting procedure : inserted in a mounting panel Sheet metal thickness : 1.5 to 5 mm *3				
Cooling System	l	Cooling naturally				
Weight		Analog resistance film type : Approx. 2.4 kg Matrix resistance film type : Approx. 2.8 kg				
Dimensions W	\times H \times D	326.4 × 259.6 × 69.0 mm				
Panel Cut-out D	Dimensions	313.0 ^{+0.5} × 246.2 ^{+0.5} mm				
Material		PC/ABS				

Wet-bulb temperature 39 °C or less

This index indicates the degree to which conductive material is generated in the environmen where the equipment is used. In pollution degree 2, only non-conductive pollution occurs but temporary conductivity may be produced due to condensation

Even when the mounting panel thickness is within the specified range, the panel itself may warp depending on the material and size of the mounting panel. Use a panel that can withstand the forces of mounting

Names of Components and Dimensions

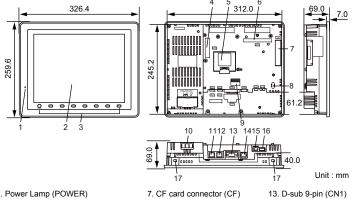

8. USB cable clamp hole

9. DIP switches

- 1. Power Lamp (POWER)
- Display
 Function keys
- Communication unit connector (CN5) *
- 10. Power supply terminal block11. Modular jack1 (MJ1) 5. Battery holder
- 6. Optional unit connector (CN7) 12. Modular jack2 (MJ2)
- * The supported communication unit differs depending on the V8 model name. N included : comm. unit 'CUN-xx' supported N not included : comm. unit 'CU-xx' supported

Interface

D-sub 9-pin (CN1)

This connector is used for serial communication (RS-232C/RS-422/RS-485) with an external device

CN1	Pin		RS-232C	RS-422/RS-485 *1	
(Female, inch screw thread)	No.	Signal	Contents	Signal	Contents
	1	NC	Not used	+RD	Receive data (+)
	2	RD	Receive data	-RD	Receive data (-)
5 1	3	SD	Send data	-SD	Send data (-)
4	4	NC	Not used	+SD	Send data (+)
	5	SG	Signal ground	SG	Signal ground
+	6	NC	Not used	+RS	Request to send (+)
9 6	7	RS	Request to send	-RS	Request to send (-)
FG: Frame Ground	8	CS	Clear to send	NC	Not used
	9	NC	Not used	+5 V	Use prohibited *2

- Select the signal level (RS-232C or RS-422/RS-485) by changing the software setting. When selecting RS-232C, be sure to set the DIP switches 5 and 7 to OFF.
- This is used when RS-422/RS-485 is selected. However, this is used as the power supply of the terminating resistance for communication with a specific device, and cannot be used as an external power supply. (For details, refer to the separate V8 Series Hardware Specifications manual.)

Modular Jack (MJ1/MJ2)

The MJ1 and MJ2 connectors are used for serial communication (RS-232C/RS-485) with an external device. The MJ1 connector can also be used for screen data transfer

MJ1/MJ2	Pin No.	Signal	Contents
	1	+RD/+SD	RS-485 data (+)
	2	-RD/-SD	RS-485 data (-)
	3	+5 V	Externally complied 15 V May 150 m A
111111111111111	4	75 V	Externally supplied +5 V, Max. 150 mA
	5	SG	Signal ground
87654321	6	36	Signal ground
FG: Frame Ground	7	RD	Receive data
	8	SD	Send data

 $^{\star}\,$ The maximum current value of "externally supplied +5 V" varies depending on the option configuration; whether it is fully featured (communication unit + optional unit) or not. For details, refer to the separate V8 Series Hardware Specifications manual

LANConnector (LAN) V812i only

The LAN connector is used for Ethernet communication (100BASE-TX, 10BASE-T). Specification: IEEE802.3(u) compliant, supporting UDP/IP and TCP/IP

For more information on the LAN connectors or cables, refer to the separate V8 Series Hardware

USB Port (USB Ver. 1.1)

Applica tions Connecting a USB printer (EPSON's STYLUS PHOTO), a USB-CFREC, etc. Connecting a computer (used for screen data transfer) and a PictBridg printer	Type	USB-A (Master)	USB-B (Slave)
			screen data transfer) and a PictBridge

For more information on the USB port or cable clamp procedure, refer to the separate V8 Series Hardware Specifications manua

DIP Switches

Setting of DIP switches is as follows. (The following figure shows the DIP switch setting upon delivery.) Before setting the DIP switch, turn the power off


(Enlarged view) ON 1 2 3 4 5 6 7 8	No.	Contents	No.	Contents
	1	CF auto-loading	5	+SD/-SD terminal resistance of CN1
	2	CF access control	6	MJ1 terminal resistance
	3	Not used	7	+RD/-RD terminal resistance of CN1
	4		8	MJ2 terminal resistance

For details, refer to the separate V8 Series Hardware Specifications manual

Mounting Procedure

Mounting Procedure

- 1. Insert the unit into the mounting panel (max. thick: 5 mm)
- Insert four fixtures attached to the V8 unit into the mounting holes, and tighten them with the locking screws. (Tightening torque: 0.5 to 0.7 N m)
- * To prevent static electricity, be sure to connect the mounting panel to the ground



3. Mount the gasket so that it will be sandwiched securely between the unit and the mounting panel

Mounting Angle


14. LAN connector (LAN)

15. USB-B port (U-B)

16. USB-A port (U-A)

17. Fixture holes

The V8 shall be installed within the angle of 0 to 135 degrees



Electrical Wiring and Grounding

Shut the power off before connecting the power supply cable


. Connect the power supply cable to the terminal on the backside of the unit

Power Supply Cable Connection

• When connecting the power supply cable, tighten it in the following torque


Electric shock hazard

Screw Size Tightening Torque M3.5 7.1 inch-lbf (0.8 N • m) The power source must be within the allowable




- voltage fluctuation. Use a power source with low noise between the cables or between the ground and the cable
- Use as thick a power supply cable as possible to minimize drop in voltage.
 Keep power supply cables away from high-voltage, large-current carrying cables
- . Be sure to attach the terminal cover to the terminal block


Grounding




• An independent earth pole must be used for MONITOUCH. • Use a cable which has a nominal cross section of more than 2 mm² for grounding

Set the grounding point near MONITOUCH to shorten the distance of grounding cables.







The battery is used for the user memory area (non-volatile memory \$L and \$LD, storing sampling data, etc.) in SRAM, or backup battery for the built-in clock

MONITOUCH is delivered with inserting the battery in the socket. For more information on the battery specifications, procedure of battery replacement or disposal of the

Hakko Electronics Co., Ltd.

used battery, refer to the separate V8 Series Hardware Specifications manual

890-1, Kamikashiwano-machi, Hakusan-shi, Ishikawa, 924-0035 Japan

Sales TEL+81-76-274-2144 FAX+81-76-274-5136 http://www.monitouch.com

Contact information in each country (company name and address):

URL http://www.hakko-elec.co.ip/en/distributors/index.html